



National Electric Power Regulatory Authority Islamic Republic of Pakistan

NEPRA Tower, Attaturk Avenue (East), G-5/1, Islamabad.
Ph: +92-51-9206500, Fax: +92-51-2600026
Web: www.nepra.org.pk, E-mail: registrar@nepra.org.pk

Registrar

No. NEPRA/R/DL/LAG-386/16024-30

September 25, 2017

Mr. Muhammad Mudassir Iqbal,
Head-Energy Business,
Two Star Energy (Private) Limited,
City Towers, 9th Floor 6-K,
Main Boulevard, Gulberg II,
Lahore.
Tel. 042-35770001-3

**Subject: Grant of Generation Licence No. IGSPL/91/2017
Licence Application No. LAG-386
Two Star Energy (Private) Limited (TSEPL)**


Reference: TSEPL application vide letter dated February 17, 2017.

Enclosed please find herewith Determination of the Authority in the matter of Application of Two Star Energy (Private) Limited (TSEPL) for the Grant of Generation Licence along with Generation Licence No. IGSPL/91/2017 annexed to this determination granted by the National Electric Power Regulatory Authority (NEPRA) to TSEPL for its 49.80 MW Bagasse based Co-Generation Facility located at Ada Kot Khetran, Toba Chichawatni Road, Tehsil Kamalia, District Toba Tek Singh, in the province of Punjab, pursuant to Section 15 of the Regulation of Generation, Transmission and Distribution of Electric Power Act (XL of 1997).

2. Please quote above mentioned Generation Licence No. for future correspondence.

**Enclosure: Generation Licence
(IGSPL/91/2017)**




25 09 17
(Syed Safer Hussain)

Copy to:

1. Secretary, Power Division, Ministry of Energy, A-Block, Pak Secretariat, Islamabad.
2. Chief Executive Officer, Alternative Energy Development Board (AEDB), 2nd Floor, OPF Building, G-5/2, Islamabad.
3. Chief Executive Officer, NTDC, 414-WAPDA House, Lahore.
4. Chief Executive Officer, CPPA-G, ENERCON Building, Sector G-5/2, Islamabad.
5. Chief Executive Officer, Faisalabad Electric Supply Company Limited, Canal Road, Faisalabad
6. Director General, Environment Protection Department, Government of Punjab, National Hockey Stadium, Ferozepur Road, Lahore.

National Electric Power Regulatory Authority
(NEPRA)

Determination of the Authority
in the Matter of Application of Two Star Energy (Private) Limited
for the Grant of Generation Licence


September 25, 2017
Case No. LAG-386

(A). Background

(i). In order to commercially harness the potential of the Renewable Energy (RE) resources in the country, the Government of Pakistan (GoP) has set up an entity in the name of Alternative Energy Development Board (AEDB) which acts as a one window facilitator for the prospective investors.

(ii). The GoP through AEDB has formulated "the Policy for Development of Renewable Energy for Power Generation 2006" (hereafter the "RE Policy"). Initially the scope of the RE Policy included development of Hydro, Wind, and Solar Technologies. Later on, the GoP amended the scope of the RE Policy to include power projects based on bagasse, biomass, waste-to-energy and bio-energy, using high-pressure (minimum 60 bar) boiler technology. Further, GoP also extended the applicability of the RE Policy for an additional five (05) years w.e.f. March 06, 2013. In consideration of the said, AEDB has issued Letter of Intent (Lol) to different entrepreneurs/ project developers. One of such Lol has been issued to Two Star Energy (Private) Limited (TSEPL), for setting up a 49.80 MW Bagasse based power project to be located in tehsil Kamalia in district Toba Tek Singh, in the province of Punjab.

(iii). According to the terms and conditions of the Lol, the sponsors (i.e. RYK group, Umer group and other individuals) of the project were required to approach the Authority for the grant of generation licence and acceptance of the already determined up-front tariff.

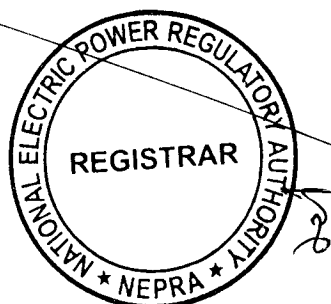

(B). Filing of Application


(i). TSEPL submitted an application on February 17, 2017 for the grant of generation licence in terms of Section-15 of Regulation of Generation, Transmission and Distribution of Electric Power Act, 1997 (the "NEPRA Act") read with the relevant provisions of the NEPRA Licensing (Application and Modification Procedure) Regulations, 1999 (the "Licensing Regulations").

(ii). The Registrar examined the submitted application to confirm its compliance with the Licensing Regulations and observed that the application lacked some of the required information/documentation. Accordingly, TSEPL was directed to submit the missing information/documentation and the same was received on March 10, 2017. The Authority considered the matter and found the form and content of the application in substantial compliance with Regulation-3 of the Licensing Regulations. Accordingly, the Authority admitted the application on March 28, 2017 for consideration of the grant of the generation licence as stipulated in Regulation-7 of the Licensing Regulations. The Authority approved an advertisement to invite comments of general public, interested and affected persons in the matter as stipulated in Regulation-8 of the Licensing Regulations. Accordingly, notices were published in one (01) Urdu and one (01) English newspapers on March 31, 2017.

(iii). In addition to the above, the Authority also approved a list of stakeholders for seeking their comments for the assistance of the Authority in the matter in terms of Regulation-9(2) of the Licensing Regulations. Accordingly, letters were sent to different stakeholders as per the approved list.


(C). Comments of Stakeholders

(i). In reply to the above, the Authority received comments from three (03) stakeholders including Anwar Kamal Law Associates (AKLA), AEDB and Ministry of Petroleum and Natural Resources (MoP&NR). The salient points of the comments offered by the said stakeholders are summarized below:-

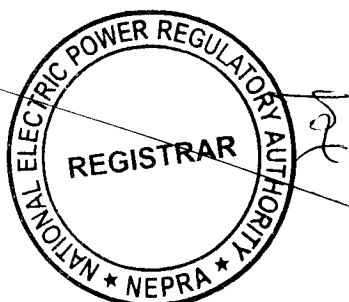

- (a). AKLA highlighted different issues pertaining to the power sector of the country including (a). surplus capacity; (b) underutilization of power plants; and (c). induction of new power plants on "Take or Pay" basis etc. Further, AKLA contested that RE power plants are not viable financially and economically due to higher upfront tariff and "must run condition". AKLA also questioned the induction of RE projects in the current scenario (i.e. reduction in oil prices, RLNG contract with Qatar, upcoming coal power projects and introduction of competitive market etc.), affordability vs. availability of electric power and long term PPAs on "Take or Pay" basis etc. AKLA stated that it not against setting up of new power plants and in this regard a very careful estimate of required generation capacities should be made or the licences should be granted on "Take and Pay" basis;
- (b). AEDB confirmed the issuance of the Lol for the project in terms of the RE Policy. Further, AEDB supported the issuance of generation licence to the project subject to fulfilment of all codal formalities in the matter; and
- (c). MoP&NR commented that the proposed project TSEPL is primarily proposed to operate on bagasse therefore, it has nothing to comment thereon.


(ii). The Authority reviewed the above comments of the stakeholders and decided to seek the perspective of TSEPL on the observations of AKLA. In reply to the said, TSEPL submitted that points raised by AKLA relate to the policies of GoP for promotion of RE in the country and have been filed without fully appreciating the dynamics of the project, energy sector, financial and technical considerations relevant for determining project parameters. The biggest concern expressed by

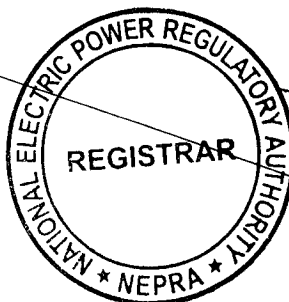

AKLA is that the projects are being planned on “Take or Pay” and the same may be changed to “Take and Pay”. Under the current structure of the power sector which is governed by the regulated tariffs, till such time a flawless mechanism and market structure is introduced which can protect the interest of the power producer in terms of their ability to meet their fixed costs, a “Take and Pay” tariff structure for power projects is not bankable.


(iii). Further to the above, TSEPL submitted that the renewable energy and greater use of indigenous resources can help diversify the energy mix of the country and reduce the dependence on imported fossil fuels, thereby mitigating against supply disruptions and price fluctuation risks. Bagasse based projects being set up by sugar mills are virtually foreign currency neutral. All fuel is locally generated and procured, projects are being financed by local banks in local currency and there is no foreign currency repatriation of dividends since all equity is being contributed by sugar mills in local currency. In case of other projects, the above three factors are expected to put considerable pressure on foreign currency requirement of the country in the future.

(iv). TSEPL further stated that AKLA in its comments claimed that generation capacity of Pakistan is surplus. It appears that the commentator is not fully aware about the operational capacity and installed capacity, for instance the installed capacity of the hydro projects cannot operate at full load throughout the year as it is dependent on the hydrology. Furthermore, a sizeable portion of installed capacity is inefficient and not economically viable to be operated. Regarding the comparison of the project with furnace oil based generation facilities, TSEPL highlighted that in the best scenario of the current low fuel prices, even the tariff for bagasse based projects is very much comparable. Further, the bagasse based projects being based on indigenous resource, do not result in drainage of any foreign exchange reserves. TSEPL concluded that in the long run and on a levelized basis, the tariff for the bagasse based project would essentially be lower than fuel based projects considering that prices of fuel are highly volatile and cannot be assumed at the current low level.

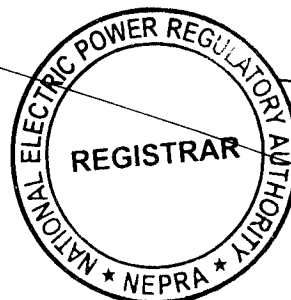

(v). TSEPL submitted that although there are projects under construction on coal and RLNG fuels, however, the ever-increasing demand of electricity will continue to exist therefore, RE has to maintain a sizeable share in the overall energy mix. It is pertinent to mention that indigenous renewable sector will result in savings of precious foreign exchange. Presently, Pakistan has the lowest contribution of renewable in the energy mix which needs to be improved to the level of other developing countries.

(vi). The Authority has considered comments of the stakeholders, reply of TSEPL and observed that AKLA while submitting its comments has referred to its previous correspondences made on different issues including (a). surplus capacity; (b). capacity payment without supplying electricity; (c). addition of high cost renewable plants; (d). underutilization of power plants; and (e). induction of new power plants on "Take or Pay" basis and others. In this regard, the Authority observes that it has duly addressed the aforementioned objections/comments and sent a comprehensive reply to AKLA through letter no. NEPRA/SAT-I/TRF-100/17060, dated December 27, 2016. The Authority reiterates its earlier findings and observations given in the aforementioned letter and is of the considered opinion that there is considerable supply demand gap resulting in load-shedding and load management. It is substantiated by the fact that the proposed generation facility of TSEPL is included in the future expansion plan of Faisalabad Electric Supply Company Limited (FESCO) for which it has already given a consent to Central Power Purchasing Agency (Guarantee) Limited (CPPA-G) which acts as an agent for the utilities. Further, CPPA-G has also filed a power acquisition request for purchasing power from TSEPL. Regarding the observations of AKLA that RE projects should have "Take and Pay" tariff, the Authority hereby clarifies that it had already determined an upfront tariff which is on unit delivered basis which means that a power producer/generation company is paid only for the energy it delivers. In view of foregoing, the Authority considers that the observations of AKLA stand addressed.

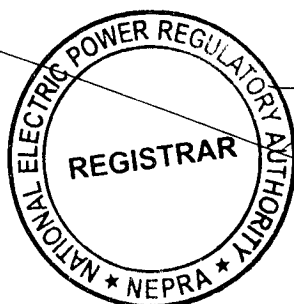


(vii). In consideration of the above and having addressed the comments/objections, the Authority considered it appropriate to proceed further in the matter of application of TSEPL for the consideration of grant of generation licence as stipulated in the Licensing Regulations and NEPRA Licensing (Generation) Rules 2000 (the "Generation Rules").

(D). Evaluation/Findings

(i). The Authority has examined the submissions of TSEPL including the information provided in its application for the grant of generation licence. The Authority has also considered the feasibility study of the project, interconnection & dispersal arrangement studies, provisions of the RE Policy, the relevant rules & regulations.


(ii). The Authority has observed that TSEPL has been incorporated as a private Limited Company under Section-16(5) of the Companies Ordinance, 2016 (VI of 2016), having Corporate Universal Identification No. 0104212 dated December 14, 2016. The registered office of the company is located at City Towers, 9th Floor 6-K, Main Boulevard, Gulberg-II, Lahore, in the province of Punjab. According to the Memorandum of Association, the objects of the company, inter alia, include electricity generation and its sale thereof;

(iii). The directors of TSEPL include Mian Mohammad Shakeel Umer, Mohammad Umer, Mr. Makhdoom Omar Shehryar and Mrs. Riffat Zamani each holding 25% of the paid up capital of the company. It is pertinent to mention that Mr. Mohammad Shakeel Umer and Mr. Mohammad Umer own Umer group which is engaged in different portfolios of investment including Textile, Footwear, Dairy, Leather, building construction and power generation. Similarly, Mr. Makhdoom Omar Shehryar and Mrs. Riffat Zamani are the co-owners of the RYK Mills Limited (RYKML) and Alliance Sugar Mills Limited (ASML) which are the leading sugar mills in Pakistan in terms of sugar production and sucrose recovery. RYKML and ASML have low pressure based electric power generation facilities at their

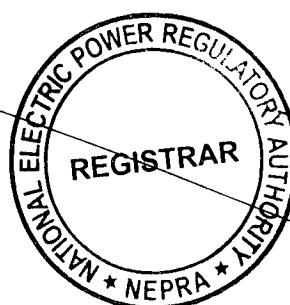

respective sugar mills. Further, RYKML has already installed a 30.00 MW high pressure boiler based generation facility which is operational for the last two years whereas, another 25.00 MW high pressure boiler based generation facility is planned to be set up and the same is expected to be commissioned in the year 2018. ASML is also setting up a 30.00 MW high pressure boiler based generation facility at its sugar mill near Dharki in the province of Sindh. Regarding the Umer group, the Authority has observed that it has installed RFO based generation facilities near Sheikhpura and Kotri with a cumulative installed capacity of 37.33 MW. The above sponsors have now acquired a new sugar mill located at Ada Kot Khetran on Toba-Chichawatni road, tehsil Kamalia, district Toba Tek Singh in the province of Punjab. The said sugar mill has crushing capacity of 14000 TCD and has its own captive power plant for which the Authority granted a generation licence (No. SGC/90/2013, dated September 03, 2013). According to the provided information, the sponsors have a net worth of around Rs. 2.00 billion. In view of the above, the Authority considers that the sponsors of TSEPL have good financial standing and rich experience in electric power generation.


(iv). The Authority has observed that based on the financial strength and other evaluation parameters, AEDB issued Lol for setting up a 49.80 MW bagasse based generation facility/co-generation facility/power plant within Two Star Industries (Pvt.) Limited (TSIPL) located at Ada Kot Khetran, on Toba-Chichawatni road, tehsil Kamalia, district Toba Tek Singh in the province of Punjab. The Authority has observed that SPV/TSEPL carried out a feasibility study of the project including inter alia, proposed equipment for generation facility/co-generation facility/power plant, soil tests reports, technical details pertaining to selection of steam turbine generator and other allied equipment, electrical studies, environmental study and project financing etc. According to the feasibility study, the project company/TSEPL will be setting up a 2 x 24.90 MW bagasse based generation facility/co-generation facility/power plant. In this regard, the sponsors have submitted necessary documents confirming that the proposed site of the project is in their name and possession.

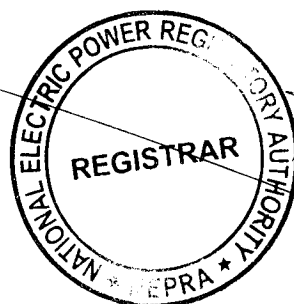

(v). In consideration of the above, TSEPL has confirmed that the proposed generation facility/co-generation facility/power plant will be consisting of 2 x 24.90 MW of steam turbine (extraction cum condensing type) with high pressure (110 bar, 540°C) travelling grate boiler. According to the submitted information, the net efficiency of the proposed generation facility/co-generation facility/power plant will be at least 24.50%. The proposed generation facility/co-generation facility/power plant will be utilizing bagasse for firing the boiler.

(vi). The Authority has observed that the proposed generation facility/co-generation facility/power plant will utilize the bagasse generated from TSIPL. In this regard, TSEPL has confirmed that the bagasse generated from TSIPL will be sufficient to operate the proposed generation facility/co-generation facility/power plant to meet with the required plant factor and plant availability as stipulated in the determination of the Authority No. NEPRA/R/TRF-UTB-2013/5152-54, dated May 29, 2013 for the upfront tariff for bagasse based projects. TSEPL has also confirmed that if there is shortage of bagasse in the area due to change in pattern of crop of sugarcane, the bagasse will be purchased from the market and will be utilized for the operation of the generation facility/co-generation facility/power plant. In view of the above, the Authority is satisfied that the project will have the required fuel for the operation of the proposed generation facility/co-generation facility/power plant.

(vii). The Authority has noted that TSEPL carried out the required Grid Interconnection Study (GIS) for dispersal of electric power from the proposed generation facility/co-generation facility/power plant. According to the said study, the dispersal of electric power will be made at 132 KV voltage level. The dispersal/interconnection arrangement will be consisting of 132 KV Double Circuit (D/C) Transmission Line (on ACSR LYNX Conductor) measuring about seven (7.00) Kilometers connecting the generation facility/co-generation power plant of TSEPL with Kamalia Grid Station of FESCO. The Authority is satisfied that FESCO has reviewed the proposal for interconnection study and accorded approval of the

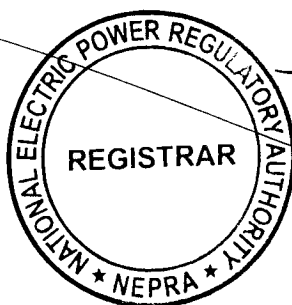


same. Further, NTDC has also endorsed the proposed arrangement for interconnection.

(viii). The Authority is encouraged that the proposed project of TSEPL will be utilizing bagasse which is RE source. However, the Authority has observed that the proposed generation facility/co-generation facility/power plant will be working as a conventional thermal power plant using steam turbine for generation of electric power/energy that may cause environmental concerns. In this regard, the Authority has observed that TSEPL carried out the Initial Environment Examination Study and Environmental Protection Agency, Government of the Punjab (EPAGoPb) has issued a No Objection Certificate (NOC) for the construction of the project.

(ix). In terms of Rule-3 of the Generation Rules, the Authority may grant a generation licence to any person to engage in the generation business. In the particular case under consideration, the Authority has observed that SHKPPL has provided details of location, technology, size, net capacity/energy, interconnection arrangements, technical limits, technical functional specifications and other details specific to the generation facilities satisfying provisions of Rule-3(2) and Rule-3(3).

(x). The Rule-3(5) of the Generation Rules stipulates that the least cost option criteria. In this regard, the Rule-3(5) of the Generation Rules stipulates the least cost option criteria necessary for the grant of generation licence which includes (a). sustainable development or optimum utilization of the RE or non-RE resources proposed for generation of electric power; (b). the availability of indigenous fuel and other resources; (c). the comparative costs of the construction, operation and maintenance of the proposed generation facility/co-generation facility/power plant against the preferences indicated by the Authority; (d). the cost and right-of-way considerations related to the provision of transmission and interconnection facilities; (e). the constraints on the transmission system likely to result from the proposed generation facility/co-generation facility/power plant and the costs of the transmission system expansion required to remove such

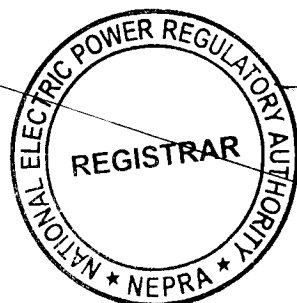


constraints; (f). the short-term and the long-term forecasts for additional capacity requirements; (g). the tariff resulting or likely to result from the construction or operation of the proposed generation facility/co-generation facility/power plant; and (h). the optimum utilization of various sites in the context of both the short-term and the long-term requirements of the electric power industry as a whole.

(xi). In consideration of the above, the Authority considers that the proposed project will result in optimum utilization of the RE which was earlier untapped, resulting in pollution free electric power. The Authority is of the considered opinion that bagasse is an indigenous fuel and such fuels should have a preference for the energy security. The Authority through its determination No. NEPRA/R/TRF-UTB-2013/5152-54, dated May 29, 2013 announced an upfront levelized tariff for the future bagasse projects which works out to be Pak. Rs. 10.4078/kWh which is very competitive considering the fact that not only cheap electric power will be generated but it will utilize the bagasse and other bio-mass which is otherwise burnt causing air and soil pollution.

(xii). As explained in the preceding paragraphs above, the sponsors of the project carried out the GIS which concludes that the project will not face any constraints in transmission system. Further, being located at reasonable distance from the thick population, the project will not result in cost and right-of-way issue for the provision of transmission and interconnection facilities. The Authority has observed that FESCO has included the project in its mid and long-term forecasts for additional capacity requirements. In view of the said, the Authority is of the considered view that the project of TSEPL fulfills the eligibility criteria for grant of generation licence as stipulated in the NEPRA Act, rules and regulations and other applicable documents.

(E). Grant of Generation Licence

(i). The sustainable and affordable energy/electricity is a key prerequisite for socio-economic development of any country. In fact, the economic growth of any country is directly linked with the availability of safe, secure, reliable

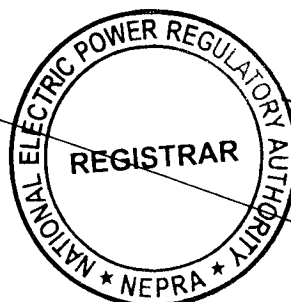


and cheaper supply of energy/electricity. In view of the said reasons, the Authority is of the considered opinion that for sustainable development, all indigenous power generation resources including RE must be developed on priority basis.

(ii). The existing energy mix of the country is heavily skewed towards the thermal power plants, mainly operating on imported fossil fuel. The continuous import of fossil fuel not only creates pressure on the precious foreign exchange reserves of the country but is also an environmental concern. Therefore, in order to achieve sustainable development it is imperative that indigenous RE resources are given priority for power generation and their development is encouraged. The Energy Security Action Plan 2005 approved by the GoP, duly recognizes this very aspect of power generation through RE and envisages that at least 5% of total national power generation capacity (i.e. 9700 MW) to be met through RE resources by 2030.

(iii). The Authority considers that the proposed project of TSEPL is consistent with the provisions of Energy Security Action Plan 2005. The project will help in diversifying the energy portfolio of the country. Further, it will not only enhance the energy security of the country by reducing the dependence on imported fuel but will also help in reducing the carbon emission by generating clean electricity, thus improving the environment.


(iv). As explained in the preceding paragraphs above, TSEPL has provided the details of location, technology, size, net capacity/energy yield, interconnection arrangements, technical details and other related information for the proposed generation facility/co-generation facility/power plant. In this regard, the Authority has observed that sponsors of the project have acquired approximately twenty (20) acres of land for setting up the generation facility/co-generation facility/power plant. The said details have been incorporated in Schedule-I of the proposed generation licence. In this regard, the Authority directs TSEPL to utilize the said mentioned land for the exclusive purpose of setting up of

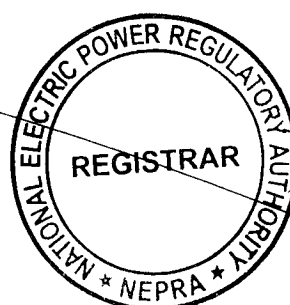

the proposed generation facility/co-generation/power plant and not to change its use except with its prior approval.

(v). The term of a generation licence under Rule-5(1) of the Generation Rules is required to match with the maximum expected useful life of the units comprised in a generating facility. According to the information provided by TSEPL, the Commercial Operation Date (COD) of the proposed generation facility/co-generation facility/power plant will be September 30, 2018 and it will have a useful life of more than thirty (30) years from its COD. In this regard, TSEPL has requested that the term of the proposed generation licence may be fixed to thirty (30) years in consistent with the term of the proposed Energy Purchase Agreement (EPA) to be signed with the power purchaser. The Authority considers that said submission of TSEPL about the useful life of the generation facility/co-generation facility/power plant and the subsequent request of TSEPL to fix the term of the generation licence is consistent with international benchmarks therefore, the Authority fixes the term of the generation licence to thirty (30) years from COD of the project.

(vi). Regarding the tariff, it is hereby clarified that under Section-7(3)(a) of the NEPRA Act, determining tariff, rate and charges etc. is the sole prerogative of the Authority. As explained in the previous paragraphs above, the project is being developed in terms of the upfront tariff for bagasse based projects, announced vide determination of the Authority No. NEPRA/R/TRF-UTB-2013/5152-54, dated May 29, 2013. In this regard, TSEPL submitted an application for acceptance of the said upfront tariff. The Authority through its determination No. NEPRA/TRF-394/TSEPL-2017/15286-15288, dated September 11, 2017 has accepted the request of TSEPL and allowed it the required tariff. The Authority directs TSEPL to adhere the terms and condition of the said determination in letter and spirit without any exception. Notwithstanding the said, the Authority directs TSEPL to charge the power purchaser only such tariff which has been determined, approved or specified by it. In this regard, the Authority decides to include Article-6 in the

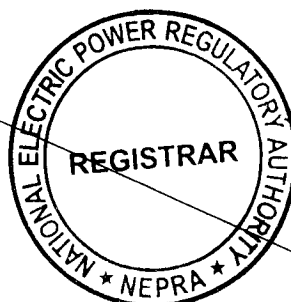


proposed generation licence and directs TSEPL to adhere to the provision of the said article of the generation licence without any exception.

(vii). Regarding compliance with the environmental standards, as explained above, TSEPL has provided the NOC from EPAGoPb and has confirmed that project will comply with the required standards during the term of the generation licence. In view of the importance of the issue, the Authority has decided to include a separate article (i.e. Article-10) in the generation licence along with other terms and conditions making it obligatory for TSEPL to comply with relevant environmental standards at all times. Further, the Authority directs TSEPL to submit a report on a bi-annual basis, confirming that operation of its generation facility/co-generation facility/power plant is in compliance with the required environmental standards as prescribed by the concerned environmental protection agency.

(viii). The proposed generation facility/co-generation facility/power plant of TSEPL will be using RE resource for generation of electric power. Therefore, the project may qualify for the carbon credits under the Kyoto Protocol. Under the said protocol, projects coming into operation up to the year 2020 can qualify for the carbon credits. TSEPL has informed that the project will achieve COD by September 30, 2018 which is within the deadline of the Kyoto Protocol. In view of the said, an article (i.e. Article-12) for carbon credits and its sharing with the power purchaser has been included in the generation licence. Foregoing in view, the Authority directs TSEPL to initiate the process in this regard at the earliest so that proceeds for the carbon credits are materialized. TSEPL will be required to share the proceeds of the carbon credits with the Power Purchaser as stipulated in Article-12 of the generation licence.


(ix). The Authority has observed that proposed generation facility/co-generation facility/power plant of TSEPL will be supplying to the power purchaser approximately 33.00 MW and 45.30 MW of clean electric power during crushing and off season respectively. In addition to supplying the national grid, TSEPL also

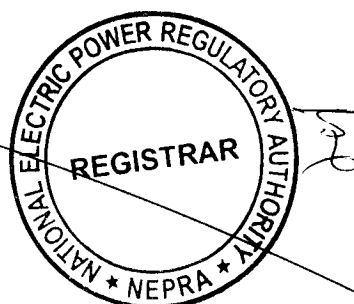

plan to supply to TSIPL to the tune of 12.80 MW and 0.50 MW during crushing season and off season respectively. According to Section-2(ii) of the NEPRA Act, a Bulk Power Consumer (BPC) is consumer which purchases or receives electric power at one premises, in an amount of one megawatt or more or in such amount and voltage level and with such characteristics as the Authority may determine. In view of said, TSIPL qualifies as BPC under the NEPRA Act and accordingly the Authority declares TSIPL a BPC of TSEPL.

(x). Regarding supply to TSIPL, the Authority observes that both TSIPL and TSEPL are located within the same premises. Further, TSIPL will be supplied through two (02) underground cables/feeders of 11 KV voltage (measuring about 400-500 meters) not involving any public or third party property. Pursuant to proviso to Section-21 of the NEPRA Act, the Authority is empowered to allow a generation company to sell electric power to a BPC located in the service territory of a distribution company. In view of the said, the Authority allows the proposed arrangement to sell electricity to TSIPL. Further, under Section-2(v) of the NEPRA Act, ownership, operation, management and control of distribution facilities located on private property and used solely to move or deliver electric power to the person owning, operating, managing and controlling those facilities or to tenants thereof has not been included in the definition of "distribution". Based on the said considerations that the proposed BPC in the name of TSIPL is located within the same premises and no public area is involved, the supply of power to TSIPL by TSEPL does not constitute a distribution activity under the NEPRA Act, and TSEPL will not require a distribution licence for supplying to TSIPL.

(xi). Regarding the rates, charges and terms and conditions of tariff between TSEPL and TSIPL, it is reiterated that under Section-7(3)(a) of the NEPRA Act, determining tariff, rate and charges etc. is the sole prerogative of the Authority. However, the Authority observes that tariff between TSEPL and its BPC (i.e. TSIPL), does not affect any other consumer or third party. Therefore for the purpose of tariff, the Authority considers it appropriate to direct TSEPL and TSIPL

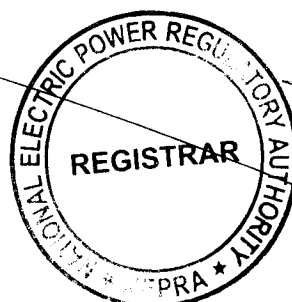


to agree on a bilateral agreement and accordingly TSEPL will be allowed to charge the agreed tariff subsequent to the grant of the generation licence.


(xii). In view of the above, the Authority hereby approves the grant of generation licence to TSEPL on the terms and conditions set out in the generation licence annexed to this determination. The grant of generation licence will be subject to the provisions contained in the NEPRA Act, relevant rules, regulations framed thereunder and other applicable documents.

Authority:


Maj. (R) Haroon Rashid
(Member)


19/9/17


Syed Masood-ul-Hassan Naqvi
(Member)

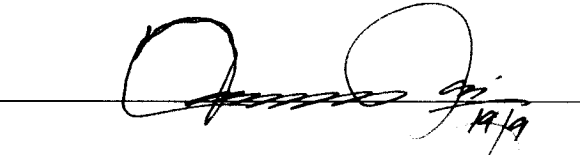
19/9


Himayat Ullah Khan
(Member)

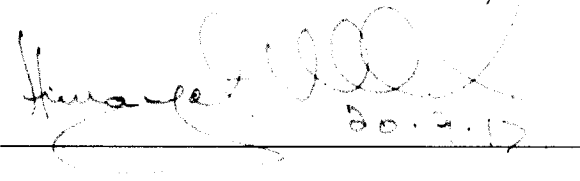

20.9.17

Saif Ullah Chattha
(Member/Vice Chairman)


22.9.2017

Tariq Saddozai
(Chairman)

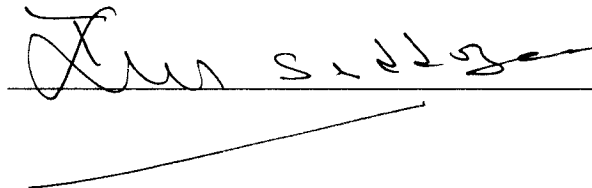

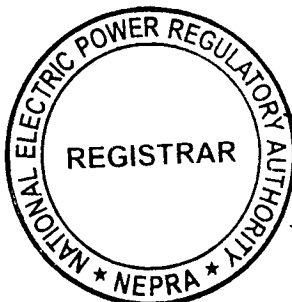

**National Electric Power Regulatory Authority
(NEPRA)
Islamabad – Pakistan**

GENERATION LICENCE

No. IGSP/91/2017

In exercise of the powers conferred under Section 15 of the Regulation of Generation, Transmission and Distribution of Electric Power Act, 1997, the Authority hereby grants a Generation Licence to:

TWO STAR ENERGY (PRIVATE) LIMITED

Incorporated Under Section-16(5) of the Companies Ordinance 2016 (VI of 2016) Having Corporate Universal Identification No. 0104212, dated December 14, 2016


for its Bagasse based Co-Generation Facility Located at Ada Kot Khetran, Toba-Chichawatni Road, Tehsil Kamalia, District Toba Tek Singh in the Province of Punjab

(Total Installed Capacity: 49.80 MW Gross ISO)

to engage in generation business subject to and in accordance with the Articles of this Licence.

Given under my hand this on 25th day of September Two Thousand & Seventeen and expires on 29th day of September Two Thousand & Forty Eight.



25 09 17
Registrar



Article-1
Definitions

1.1 In this Licence


- (a). "Act" means the Regulation of Generation, Transmission and Distribution of Electric Power Act, 1997 as amended or replaced from time to time;
- (b). "AEDB" means the Alternative Energy Development Board or any other entity created for the like purpose established by the GoP to facilitate, promote and encourage development of renewable energy in the country;
- (c). "Applicable Documents" mean the Act, the rules and regulations framed by the Authority under the Act, any documents or instruments issued or determinations made by the Authority under any of the foregoing or pursuant to the exercise of its powers under the Act, the Grid Code, the applicable Distribution Code, if any, or the documents or instruments made by the Licensee pursuant to its generation licence, in each case of a binding nature applicable to the Licensee or, where applicable, to its affiliates and to which the Licensee or any of its affiliates may be subject;
- (d). "Applicable Law" means all the Applicable Documents;
- (e). "Authority" means the National Electric Power Regulatory Authority constituted under Section-3 of the Act;

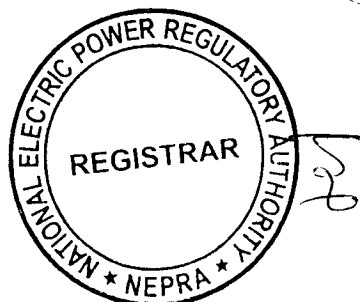


- (f). "Bulk Power Consumer (BPC)" means a consumer which purchases or receives electric power, at one premises, in an amount of one (01) megawatt or more or in such other amount and voltage level and with such other characteristics as the Authority may determine and the Authority may determine different amounts and voltage levels and with such other characteristics for different areas;
- (g). "Bus Bar" means a system of conductors in the generation facility/Co-Generation Facility/Power Plant of the Licensee on which the electric power from all the generators is collected for supplying to the Power Purchaser or BPC;
- (h). "Carbon Credits" mean the amount of Carbon Dioxide (CO₂) and other greenhouse gases not produced as a result of generation of energy by the generation facility/Co-Generation Facility/Power Plant and other environmental air quality credits and related emissions reduction credits or benefits (economic or otherwise) related to the generation of energy by the generation facility/Co-Generation Facility/Power Plant, which are available or can be obtained in relation to the generation facility/Co-Generation Facility/Power Plant after the COD;
- (i). "Co-Generation Facility/Power Plant" means the generation facility for simultaneous production of both electric power and heat or steam for industrial processes from a common fuel source;
- (j). "Commercial Operations Date (COD)" means the day immediately following the date on which the generation facility/Co-Generation Facility/Power Plant of the Licensee is commissioned;
- (k). "CPPA-G" means Central Power Purchasing Agency (Guarantee) Limited or any other entity created for the like purpose;



- (l). "Distribution Code" means the distribution code prepared by the concerned XW-DISCO and approved by the Authority, as it may be revised from time to time with necessary approval of the Authority;
- (m). "Energy Purchase Agreement (EPA)" means the energy purchase agreement, entered or to be entered into by and between the Power Purchaser and the Licensee, for the purchase and sale of electric energy generated by the generation facility/Co-Generation Facility/Power Plant, as may be amended by the parties thereto from time to time;
- (n). "FESCO" means Faisalabad Electric Supply Company Limited or its successors or permitted assigns;
- (o). "Grid Code" means the grid code prepared by NTDC and approved by the Authority, as it may be revised from time to time by NTDC with necessary approval by the Authority;
- (p). "GoP" means the Government of Pakistan acting through the AEDB which has issued or will be issuing to the Licensee a Letter of Support (LoS) for the design, engineering, construction, insuring, commissioning, operation and maintenance of the generation facility/Co-Generation Facility/Power Plant;
- (q). "IEC" means the International Electrotechnical Commission or its successors or permitted assigns;
- (r). "IEEE" means the Institute of Electrical and Electronics Engineers or its successors or permitted assigns;

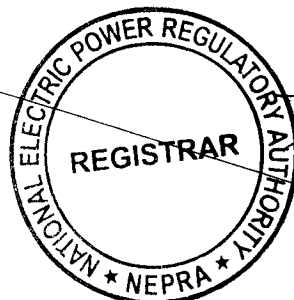

- (s). "Implementation Agreement (IA)" means the implementation agreement signed or to be signed between the GoP and the Licensee in relation to this particular generation facility/Co-Generation Facility/Power Plant, as may be amended from time to time;
- (t). "Letter of Support (LoS)" means the letter of support issued or to be issued by the GoP through the AEDB to the Licensee;
- (u). "Licensee" means Two Star Energy (Private) Limited or its successors or permitted assigns;
- (v). "NTDC" means National Transmission and Despatch Company Limited or its successors or permitted assigns;
- (w). "Policy" means the Policy for Development of Renewable Energy for Power Generation, 2006 of Government of Pakistan as amended from time to time;
- (x). "Power Purchaser" means CPPA-G which will be purchasing electric power from the Licensee either on behalf of all XW-DISCOs or any single XW-DISCO, pursuant to the EPA for procurement of electric power;
- (y). "Licensing Regulations" mean the National Electric Power Regulatory Authority Licensing (Application & Modification Procedure) Regulations, 1999 as amended or replaced from time to time;
- (z). "Generation Rules" mean the National Electric Power Regulatory Authority Licensing (Generation) Rules, 2000 as amended or replaced from time to time;

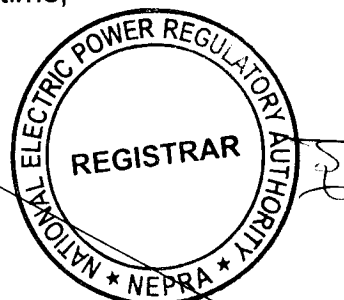

(aa). "XW-DISCO" means "an ex-WAPDA distribution company engaged in the distribution of electric power".

1.2 Words and expressions used but not defined herein bear the meaning given thereto in the Act or rules and regulations issued under the Act.

Article-2
Applicability of Law

This licence is issued subject to the provisions of the Applicable Law, as amended from time to time.


Article-3
Generation Facilities

3.1 The location, size (capacity in MW), technology, interconnection arrangements, technical limits, technical functional specifications and other details specific to the generation facility/Co-Generation Facility/Power Plant of the Licensee are set out in Schedule-I of this licence.

3.2 The net capacity of the generation facility/Co-Generation Facility/Power Plant of the Licensee is set out in Schedule-II hereto. The Licensee shall provide the final arrangement, technical and financial specifications and other specific details pertaining to its generation facility/Co-Generation Facility/Power Plant before its COD.

Article-4
Term of Licence

4.1 This licence shall become effective from the date of its issuance and will have a term of thirty (30) years from the COD of the generation facility/Co-Generation Facility/Power Plant of the Licensee.

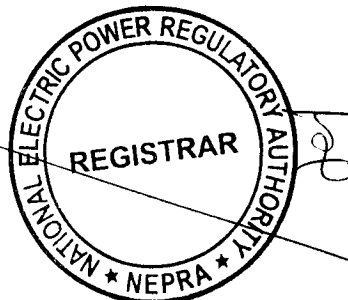

4.2 Unless suspended or revoked earlier, the Licensee may apply for renewal of this licence ninety (90) days prior to the expiry of the above term, as stipulated in the Licensing Regulations.

Article-5
Licence fee

The Licensee shall pay to the Authority the Licence fee as stipulated in the National Electric Power Regulatory Authority (Fees) Rules, 2002 as amended or replaced from time to time.

Article-6
Tariff

The Licensee shall charge the only such tariff which has been determined, approved or specified by the Authority.


Article-7
Competitive Trading Arrangement

7.1 The Licensee shall participate in such manner as may be directed by the Authority from time to time for development of a Competitive Trading Arrangement. The Licensee shall in good faith work towards implementation and operation of the aforesaid Competitive Trading Arrangement in the manner and time period specified by the Authority. Provided that any such participation shall be subject to any contract entered into between the Licensee and another party with the approval of the Authority.

7.2 Any variation or modification in the above-mentioned contracts for allowing the parties thereto to participate wholly or partially in the Competitive Trading Arrangement shall be subject to mutual agreement of the parties thereto and such terms and conditions as may be approved by the Authority.





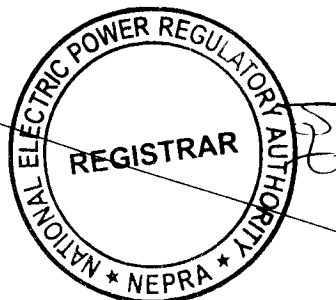

Article-8
Maintenance of Records

For the purpose of sub-rule (1) of Rule-19 of the Generation Rules, copies of records and data shall be retained in standard and electronic form and all such records and data shall, subject to just claims of confidentiality, be accessible by authorized officers of the Authority.

Article-9
Compliance with Performance Standards

The Licensee shall comply with the relevant provisions of the National Electric Power Regulatory Authority Performance (Generation) Rules 2009 as amended from time to time.


Article-10
Compliance with Environmental & Safety Standards

10.1 The generation facility/Co-Generation Facility/Power Plant of the Licensee shall comply with the environmental and safety standards as may be prescribed by the relevant competent authority from time to time.

10.2 The Licensee shall provide a certificate on a bi-annual basis, confirming that the operation of its generation facility/Co-Generation Facility/Power Plant is in conformity with required environmental standards as prescribed by the relevant competent authority.

Article-11
Provision of Information

In accordance with provisions of Section-44 of the Act, the Licensee shall be obligated to provide the required information in any form as desired by the Authority without any exception.

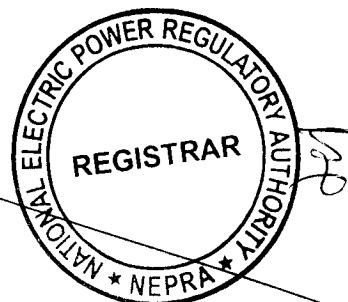

Article-12
Emissions Trading/Carbon Credits


The Licensee shall process and obtain expeditiously the Carbon Credits admissible to the generation facility/Co-Generation Facility/Power Plant. The Licensee shall share the said proceeds with the Power Purchaser as per the Policy.

Article-13
Power off take Point and Voltage

The Licensee shall deliver the electric power to the Power Purchaser at the outgoing Bus Bar of its generation facility/Co-Generation Facility/Power Plant. The Licensee shall be responsible for the up-gradation (step up) of generation voltage up to the required dispersal voltage level.


Article-14
Design & Manufacturing Standards

The generation facility/Co-Generation Facility/Power Plant of the Licensee shall be designed, manufactured and tested according to the latest IEC, IEEE or other equivalent standards. All the plant and equipment of the generation facility/Co-Generation Facility/Power Plant shall be unused and brand new.


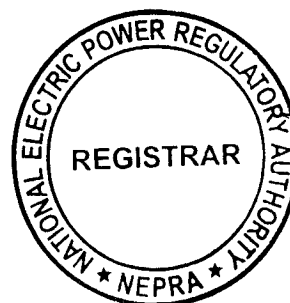


SCHEDULE-I

The Location, Size (i.e. Capacity in MW), Type of Technology, Interconnection Arrangements, Technical Limits, Technical/Functional Specifications and other details specific to the Generation Facilities of the Licensee are described in this Schedule.

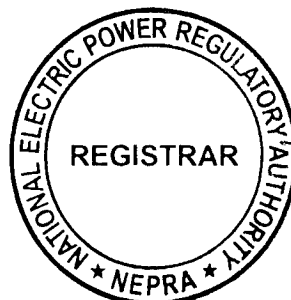


**Location of the
Generation Facility/Co-Generation Facility/Power Plant
of the Licensee on Map of Pakistan**

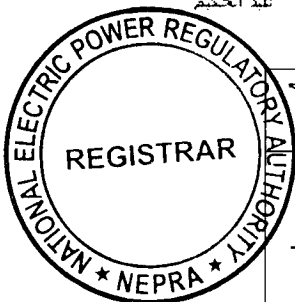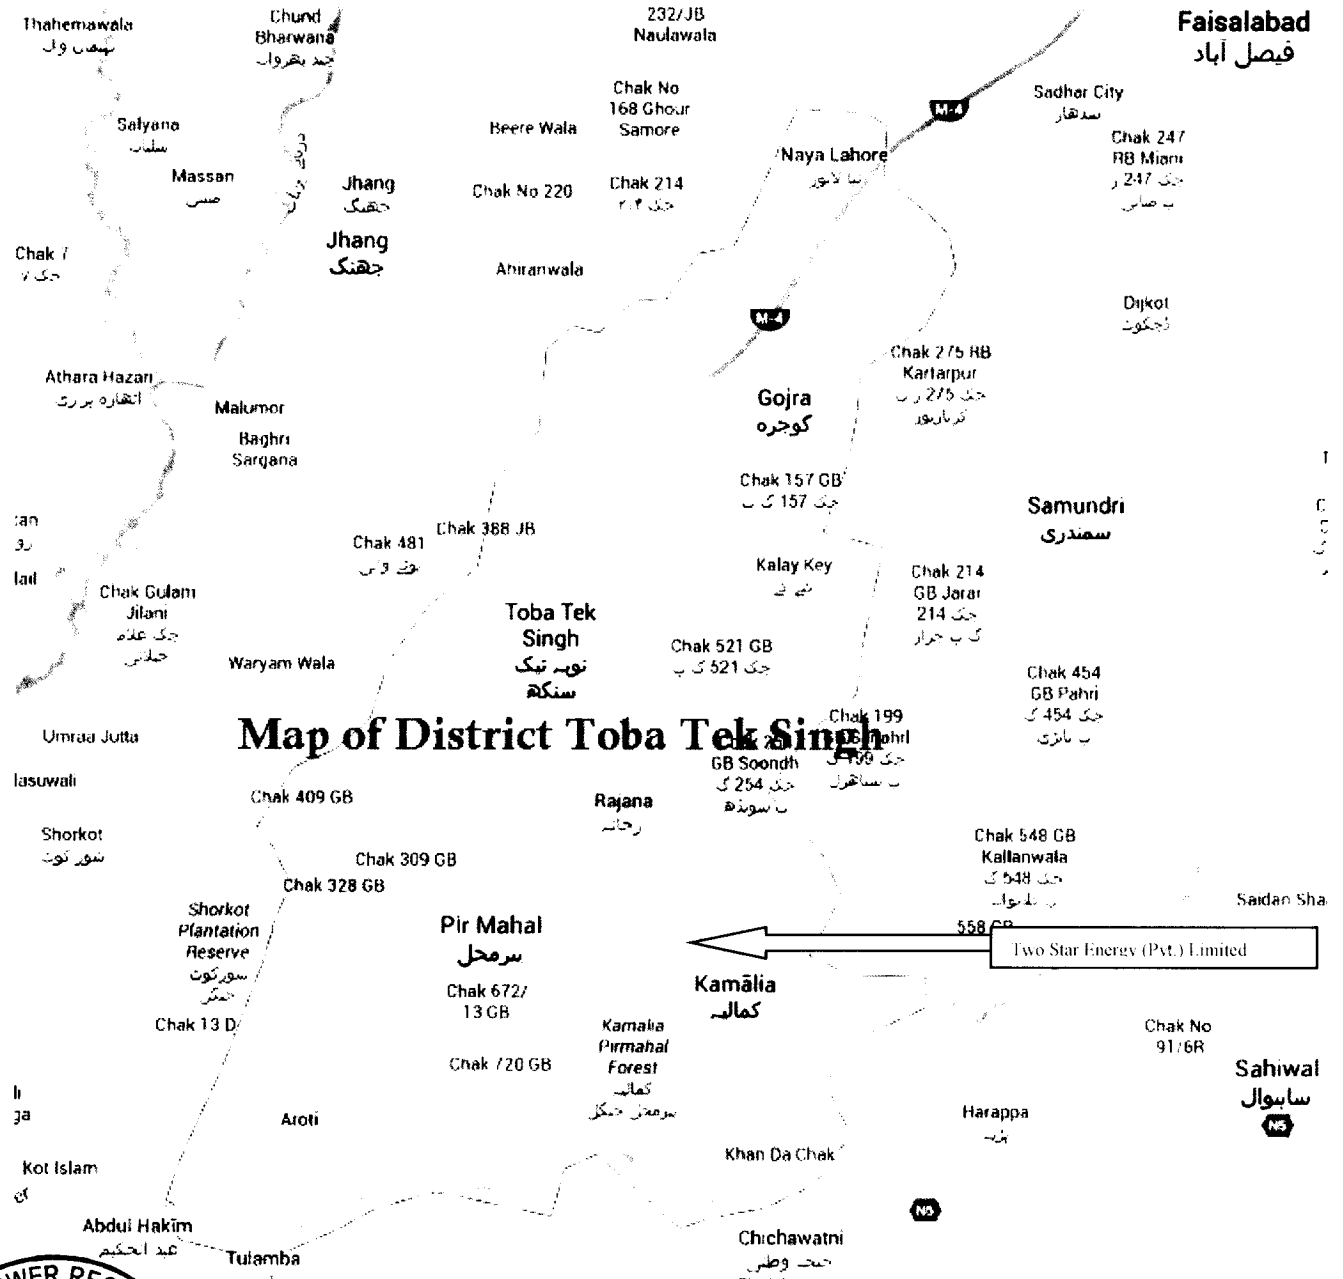


Site Address	Longitude	Latitude
Ada Kot Khetran, Toba-Chichawatni Road Tehsil Kamalia, District Toba Tek Singh, Province of Punjab	30.758709 N	72.579567 E

**Location of the
Generation Facility/Co-Generation Facility/Power Plant
of the Licensee on Map of the Province of Punjab**

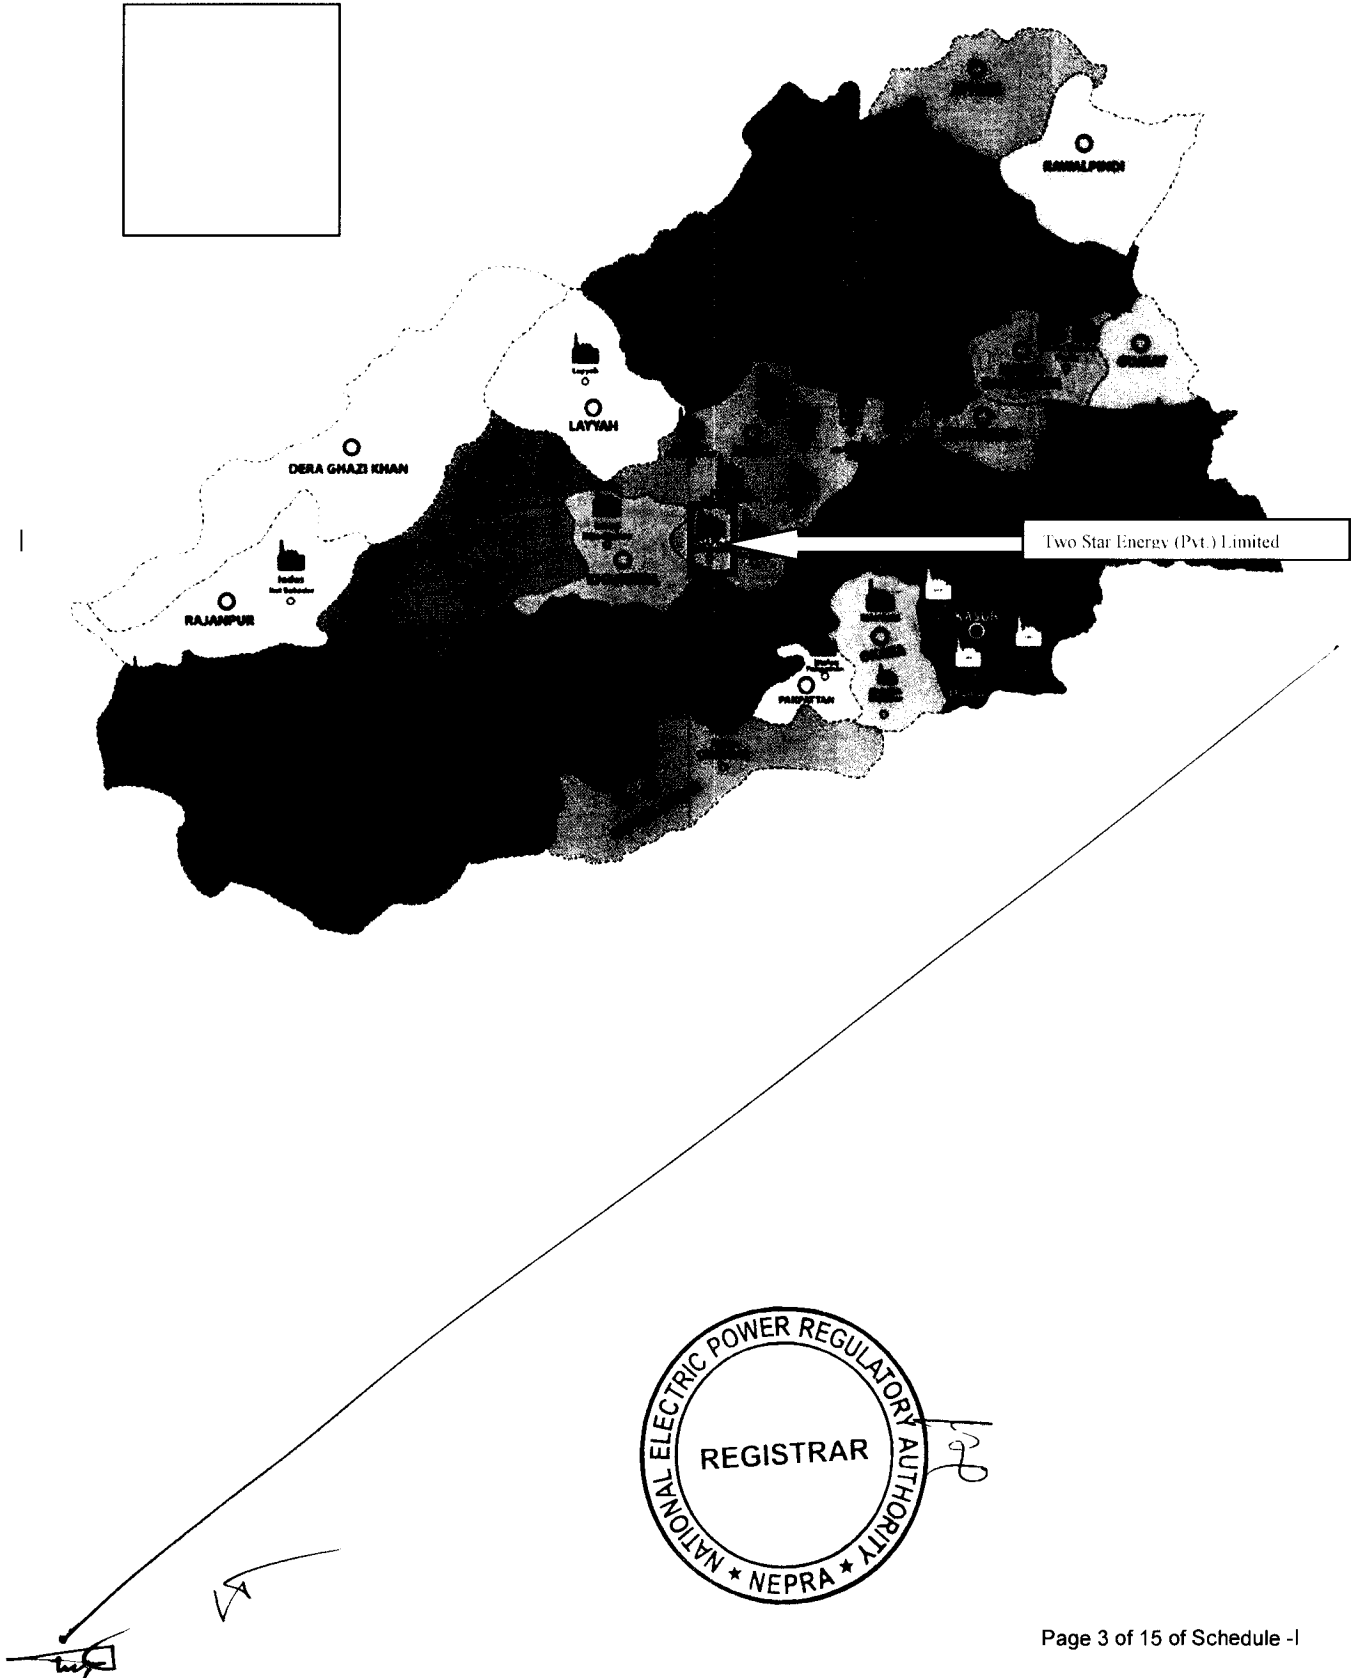


Land Coordinates
of the Co-Generation Facility/Thermal Power Plant of the
Company/Licensee

Site Address	Longitude	Latitude
Ada Kot Khetran, Toba-Chichawatni Road Tehsil Kamalia, District Toba Tek Singh, Province of Punjab	30.758709 N	72.579567 E

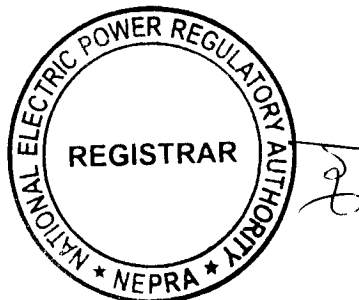

Lay-out of the
Generation Facility/Co-Generation Facility/Power Plant
of the Licensee


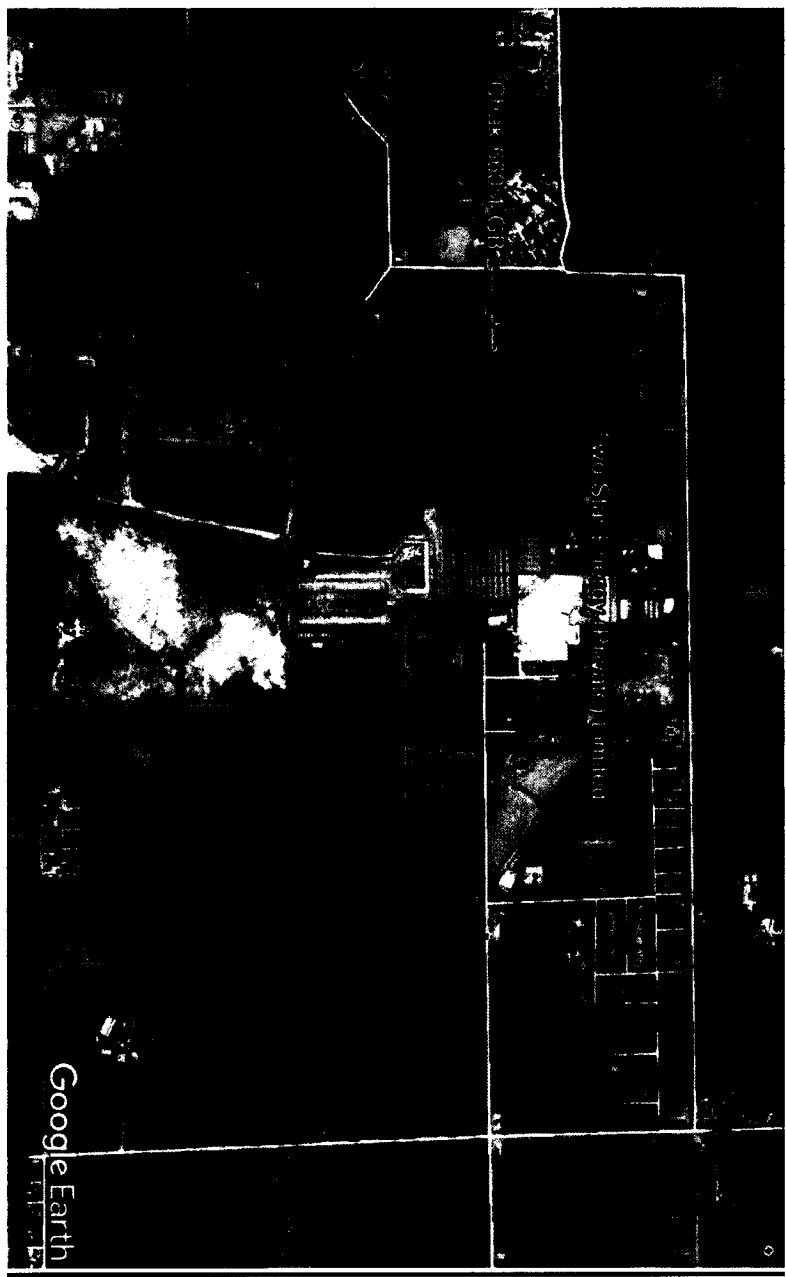


[Handwritten signature]

[Handwritten mark]

NATIONAL ELECTRIC POWER REGULATORY AUTHORITY
REGISTRAR
NEPRA

**Process Diagram of the
Generation Facility/Co-Generation Facility/Power Plant
of the Licensee**

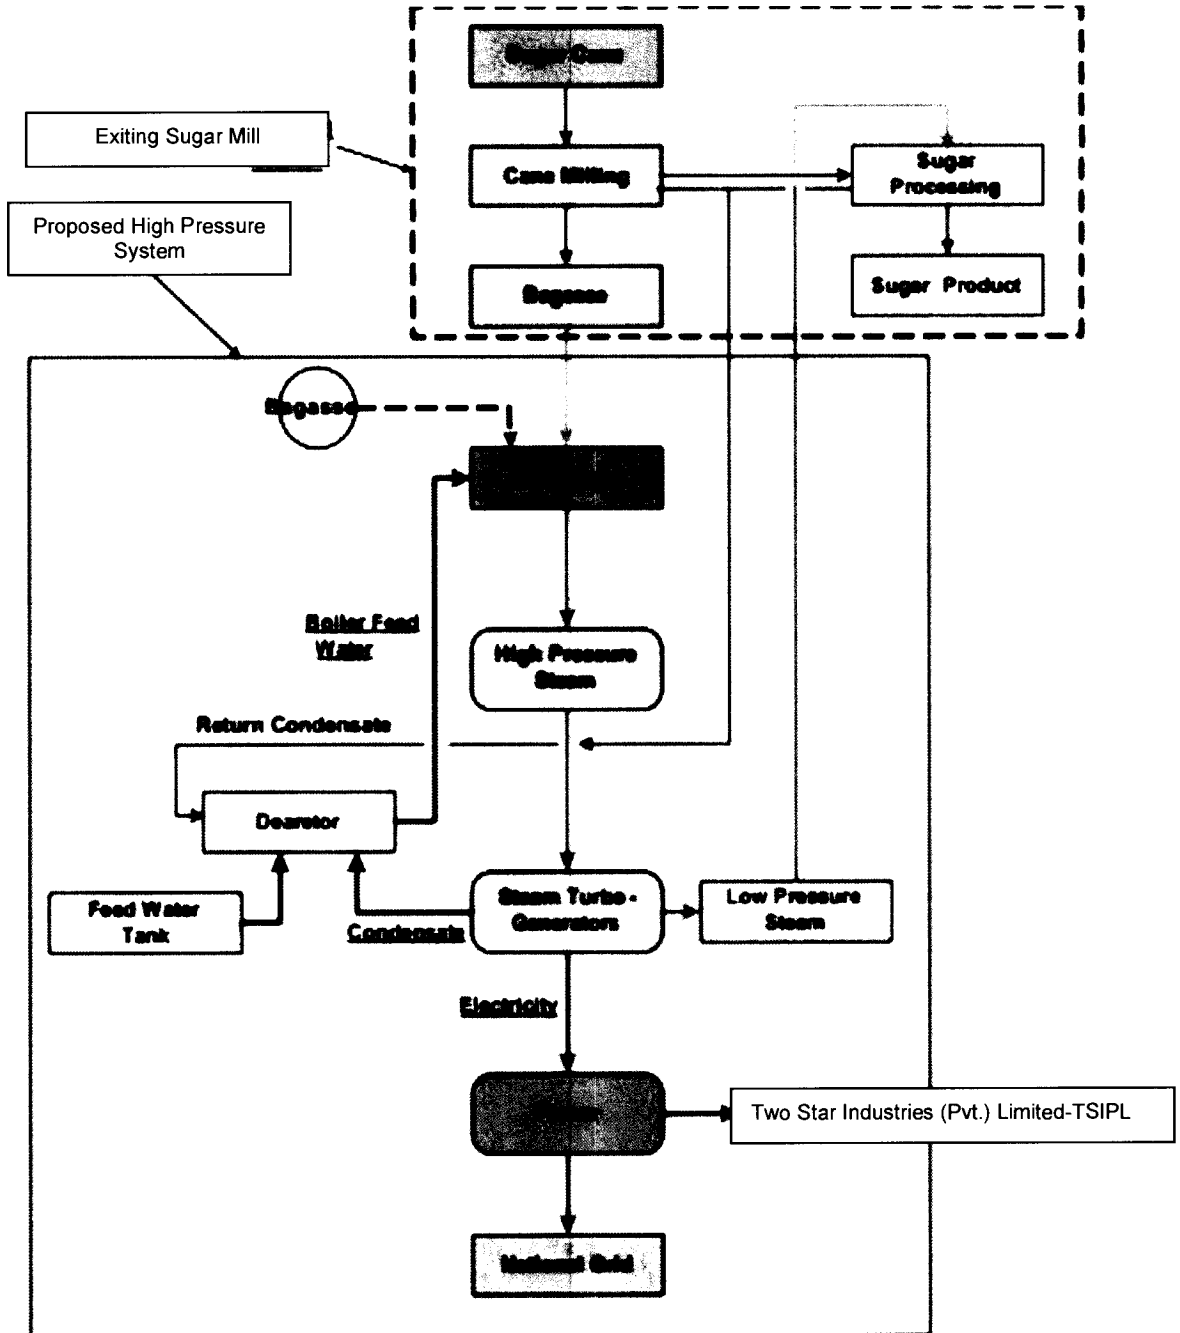


**Interconnection Arrangement for
Dispersal of Electric Energy/Power from the Generation
Facility/Co-Generation Facility/Power Plant**

The electric power from the Bagasse based Co-Generation Facility/Co-Generation Power Plant of Licensee will not only be supplied to a Bulk Power Consumer-BPC* [i.e. Two Star Industries (Pvt.) Limited-TSIPL] as enumerated in this Schedule-I) but also to the load center of FESCO.



(2). The interconnection facilities/transmission arrangement for supplying to FESCO from the above-mentioned generation facility shall be at 132 KV level. The dispersal/interconnection arrangement for supplying to FESCO will be consisting of a 132 KV Double Circuit (D/C) Transmission Line (on ACSR LYNX Conductor) measuring about seven (7.00) Kilo-Meter connecting the generation facility/Co-Generation Facility/Power Plant with 132 KV Kamalia grid station of FESCO.

(3). The above dispersal arrangement is based on the approval of FESCO regarding the Grid Interconnection Study. Any change in the above-mentioned arrangement for dispersal of electric energy/power as agreed by the Licensee, FESCO or the Power Purchaser shall be communicated to the Authority in due course of time.

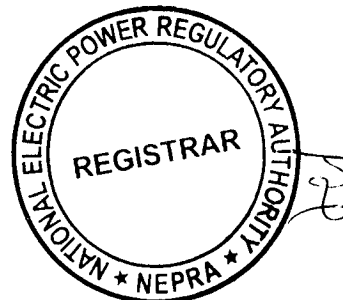

* The details of the pertaining to BPC, supply arrangement and other relating information is provided in the subsequent description of this Schedule-I.

Schematic Diagram for Dispersal of Electric Energy/Power from the Generation Facility/Co-Generation Facility/Power Plant

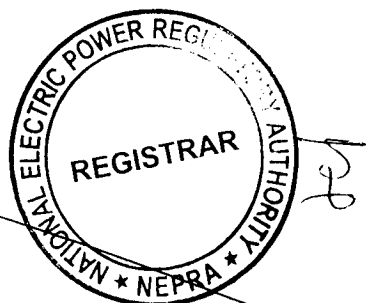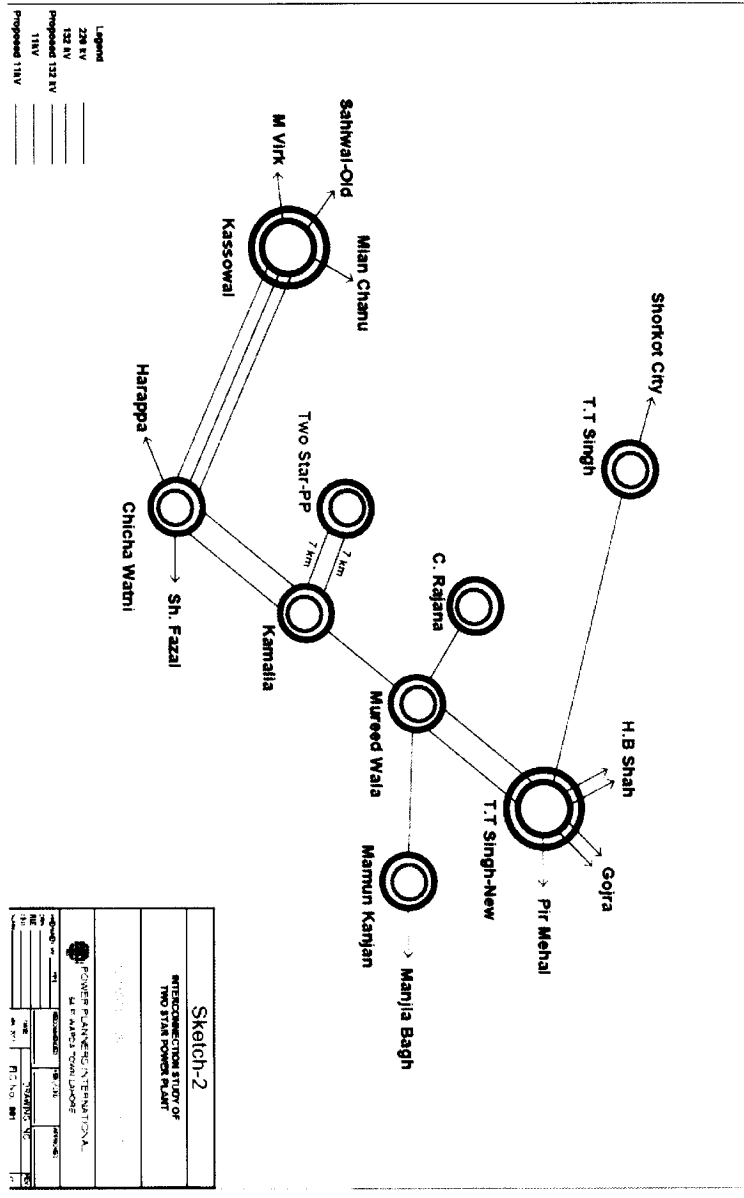


**Details of
Generation Facility/Co-Generation Facility/
Power Plant**

(A). General Information

(i).	Name of the Company/Licensee	Two Star Energy (Private) Limited
(ii).	Registered Office of the Company	City Towers, 9 th Floor 6-K, Main Boulevard, Gulberg II, Lahore
(iii).	Business Address/ Office of the Company	-Do-
(iv).	Location of the Generation Facility	Ada Kot Khetran, Toba-Chichawatni Road Tehsil Kamalia, District Toba Tek Singh in the Province of Punjab
(v).	Type of the Generation Facility	Bagasse based, high-pressure generation facility/Co-Generation Facility/Thermal Power Plant.

(B). Configuration of Generation Facility


(i).	Installed Capacity/Size of the Generation Facility	49.80 MW	
(ii).	Type of the Technology of the Generation Facility	Conventional Steam Turbine based Power Plant (2 x 24.90 MW extraction cum condensing Steam Turbine and two (02) Travelling grate bagasse fired boiler Operating at 110 bar (kg/cm ²) and each Producing 155 Tons of Steam Per Hour-TPH.	
(iii).	Number of Units & Size of Each Unit of the Generation Facility	Steam Turbine	2 x 24.90 MW



(iv).	Make/Model/Type/ Year of Manufacture Etc. of each Unit of the Generation Facility	Steam Turbine	Hangzhou Steam Turbine Co. Limited-HTC/ SKODA, SIEMENS etc.
		Boiler	Travelling grate type Boiler 155 TPH Capacity and 110 bar(kg/cm ²) Wuxi Huaguang Boiler Co.,Ltd China, DESCON, THERMAX/2017.
(v).	Expected/ Anticipated COD of the Generation Facility	September 30, 2018	
(vi).	Expected Useful Life of the Generation Facility from COD	30 Years (Minimum)	

(C). Fuel/Raw Material Details

(i).	Primary Fuel	Bagasse	
(ii).	Alternate Fuel	Furnace Oil	
(iii).	Fuel Source (Imported/Indigenous)	Primary Fuel	Alternate Fuel
		Indigenous	Indigenous
(iv).	Fuel Supplier	Primary Fuel	Alternate Fuel
		Two Star Industries (Pvt.) Limited-TSIPL (primary)/other Bagasse/Biomass suppliers (if available in the nearby area)	Shell Pakistan Limited/Pakistan State Oil-PSO

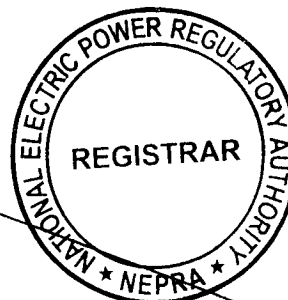

		Primary Fuel	Alternate Fuel	
(v).	Supply Arrangement	Through Conveyor Belts/Loading Trucks/Tractor Trolleys etc.	Through Oil Tankers	
(vi).	Sugarcane Crushing Capacity	14,000 Ton per day		
(vii).	Bagasse Generation Capacity	4,550 Ton per day		
(viii).	Fuel Storage facilities	Primary Fuel	Alternate Fuel	
		Bulk Storage	02 Tanks	
(ix).	Capacity of Storage facilities	Primary Fuel	Alternate Fuel	
		150,000 Metric Tons bulk storage	500 Tons	125 Tons
(x).	Gross Capacity Storage	Primary Fuel	Alternate Fuel	
		150,000 Metric Tons bulk storage	625 Tons	

(D). Emission Values

		Primary Fuel	Alternate Fuel	
(i).	SO _x	<264mg/Nm ³	<264mg/Nm ³	
(ii).	NO _x	<100 mg/ Nm ³	<100 mg/ Nm ³	
(iii).	CO ₂	11% -13%	11% -13%	
(iv).	CO	<200mg/ Nm ³	<200mg/ Nm ³	
(v).	PM ₁₀	<150mg/Nm ³	<150mg/Nm ³	




(E). Cooling System

(i).	Cooling Water Source/Cycle	Condensate water of Ground Water Turbine installed at plant site / Closed Loop
------	----------------------------	--


(F). Plant Characteristics

(i).	Generation Voltage	11.00 KV		
(ii).	Frequency	50 Hz		
(iii).	Power Factor	0.80 lagging - 0.90 leading		
(iv).	Automatic Generation Control (AGC)	Yes		
(v).	Ramping Rate	4 KW/Second		
(vi).	Time required to Synchronize to Grid	600 minutes	320 minutes	60 minutes
		During cold start (i.e. when plant is started later than 72 hours after shutdown)	During warm start (i.e. when plant is started at less than 36 hours after shutdown)	During Hot start (i.e. when plant is started at less than 12 hours after shutdown)




**Information Regarding Bulk Power Consumer(s)/
BPC(s) in the name of Two Star Industries (Pvt.) Limited-TSIPL to be Supplied
by the Licensee [(i.e. Two Star Energy (Private) Limited-TSEPL)]**

(i).	No. of Consumers		One (01)
(ii).	Location of consumers (distance and/or identity of premises)		Ada Kot Khetran, Toba-Chichawatni Road Tehsil Kamalia, District Toba Tek Singh in the Province of Punjab
(iii).	Contracted Capacity and Load Factor for consumer		During Crushing Season
			During Off Crushing Season
			12.00 MW (Max)
			0.50 MW (Max)
(iv).	Specify Whether		
	(i)	The consumer is an Associate undertaking of the TSEPL -If yes, specify percentage ownership of equity;	TSIPL and TSEPL are associated companies of the same sponsors.
	(ii)	There are common directorships:	Yes
	(iii)	Either can exercise influence or control over the other.	Yes
(v).	Specify nature of contractual Relationship		
	(i)	Between each consumer and TSEPL.	TSIPL and TSEPL are associated companies of the same sponsors.
	(ii)	Consumer and FESCO.	TSIPL is B-2 Consumer of FESCO
(vi)	Any other network information deemed relevant for disclosure to or consideration of the Authority.		N/A

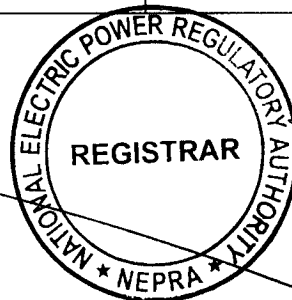


**Information Regarding
Distribution Network for Supply of Electric Power to Bulk Power Consumer
in the Name of Two Star Industries (Pvt.) Limited-TSIPL of the Licensee [(i.e.
Two Star Energy (Private) Limited-TSEPL)]**

(i).	No. of Feeders	02 (Two)	
(ii).	Length of Each Feeder (Meter)	400-500 Meter (Approximately)	
(iii).	Length of Each Feeder to each Consumer	400-500 Meter (Each Feeder to TSIPL)	
(iv).	In respect of all the Feeders, describe the property (streets, farms, Agri land, etc.) through, under or over which they pass right up to the premises of customer, whether they cross-over.	The 11 KV cables supplying power to TSIPL are located on private property owned by TSIPL, without crossing of any Public or third party Private Property etc.	
(v).	Whether owned by TSEPL, Consumer or FESCO-(deal with each Feeder Separately)		
	(a).	If owned by FESCO, particulars of contractual arrangement	N/A
	(b).	Operation and maintenance responsibility for each feeder	The Operation and Maintenance is the responsibility of TSIPL.
(vi).	Whether connection with network of FESCO exists (whether active or not)- If yes, provide details of connection arrangements (both technical and contractual)	Yes/TSIPL is B-2 Consumer of FESCO	
(vii).	Any other network information deemed relevant for disclosure to or consideration of the Authority.	N/A	

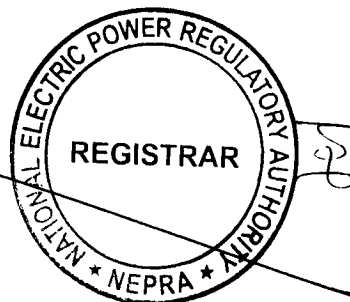

SCHEDULE-II

The Installed/ISO Capacity (MW), De-Rated Capacity at Mean Site Conditions (MW), Auxiliary Consumption (MW) and the Net Capacity At Mean Site Conditions (MW) of the Generation Facilities of Licensee are given in this Schedule

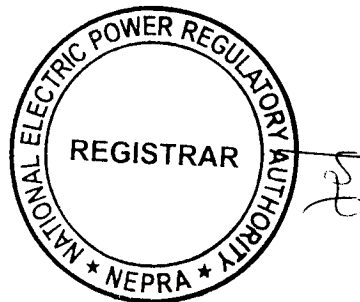


SCHEDULE-II

		<u>Season Operation</u>	<u>Off-Season Operation</u>
(1).	Total Gross Installed Capacity of the Generation Facility	49.80 MW	49.80 MW
(2).	De-rated Capacity of Generation Facility at Reference Site Conditions	49.80 MW	49.80 MW
(3).	Auxiliary Consumption of the Generation Facility	04.00 MW	04.00 MW
(4).	Average Electric Power Supplied to Bulk Power Consumer [i.e. Two Star Industries (Pvt.) Limited-TSIPL) from the Generation Facility at Reference Site Condition	12.80 MW	00.50 MW
(5).	Total Installed Net Capacity of Generation Facility at Reference Site Condition	33.00 MW	45.30 MW

Note

All the above figures are indicative as provided by the licensee. The net capacity available to Power Purchaser for dispatch will be determined through procedure(s) contained in the Energy Purchase Agreement/bi-lateral agreement or any other applicable document(s).

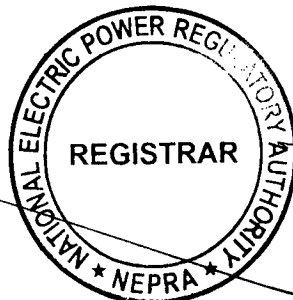


Authorization
by National Electric Power Regulatory Authority (NEPRA) to
Two Star Energy (Private) Limited

Incorporated Under Section-16(5) of the
Companies Ordinance 2016 (VI of 2016) Having Corporate Universal
Identification No. 0104212, dated December 14, 2016

For
Sale to Bulk Power Consumer

Pursuant to Section-21 of the Act and Rule-7 of the NEPRA Licensing
(Generation) Rules-2000, the Authority hereby authorize Two Star Energy (Private)
Limited-TSEPL (the Licensee) to engage in second-tier supply business, limited to the
following consumers:-


- (a). Two Star Industries (Pvt.) Limited-TSIPL.



(Maj. (R) Haroon Rashid)
Member



(Syed Masood Ul Hassan Naqvi)
Member

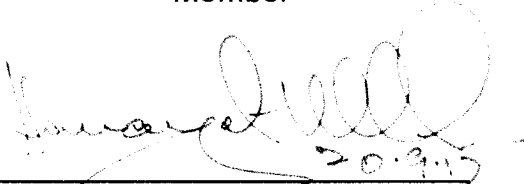

(Himayat Ullah Khan)
Member




(Saif Ullah Chattha)
Vice Chairman/Member 22-9-2017



(Tariq Saddozai)
Chairman




25-09-17